


DO NOT SCALE

- 1/ TYPE XB3,LED3,FL3 & FB3
- 2/ CERTIFICATION No. - BASEEFA Ex92C1389
- 3/ WEIGHT :- XB3 / LED3 - 4.5Kg ± 0.3 (STAINLESS STEEL VERSION)
XB3 / LED3 - 2.0Kg ± 0.3 (ALUMINIUM VERSION)
FL3 / FB3 - 4.8Kg ± 0.3 (STAINLESS STEEL VERSION ONLY)
- 4/ MATERIAL:- STAINLESS STEEL GRADE 316/ANC 48 TO BS 3146:1975
OR ALUMINIUM ALLOY GRADE LM25TF TO BS 1490:1988.
- 5/ TAG LABEL LETTER SIZE 5mm MAX.
- 6/ TERMINALS SUITABLE FOR UP TO 6.0mm SQ CABLE AS STANDARD.
- 7/ CABLE ENTRIES AVAILABLE AT "B" "L" "R" A MAXIMUM OF ONE ENTRY PER FACE.
- 8/ HYLOMAR PL32 SEALANT APPLIED TO ALL CERTIFIED BLANKING PLUGS.

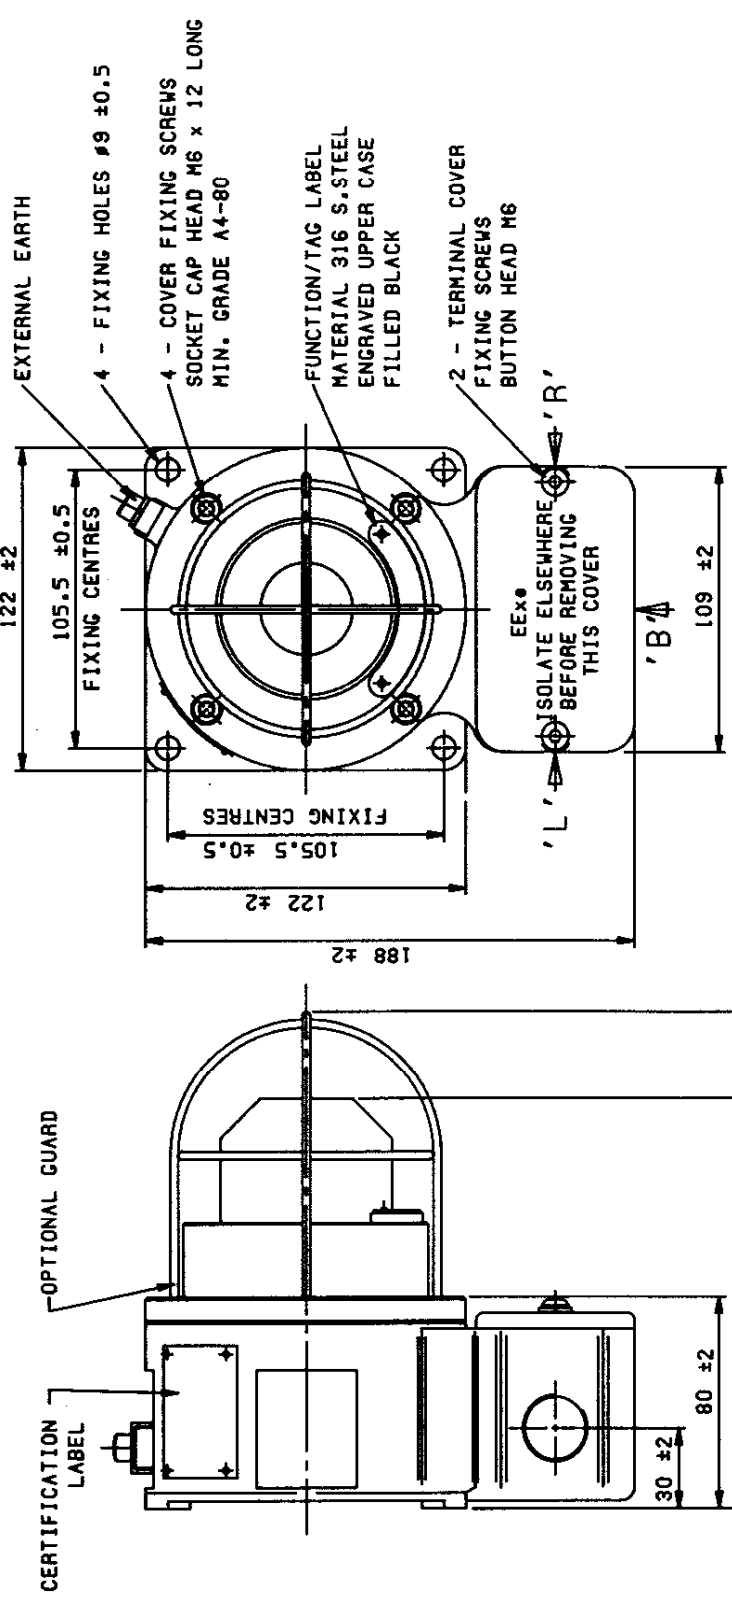

MEDCO

MEDC, Colliery Road, Pinxton,
Nottingham NG16 6JF, U.K.
Tel: Ripley (01773) 812249
Fax: (01773) 580282

ISSUES				A4				A			
XB3, LED3, FL3 & FB3				GENERAL ARRANGEMENT				5086-01-01			
DRN. CE 31/96				TITLE				SIZE			
CH'D 24/23/96				SCALE				METRIC DIMENSIONS ONLY (U.O.S.)			
AP'D SM				PATENTS, DESIGNS AND COPYRIGHT ARE RESERVED.				THIS DRAWING IS THE PROPERTY OF MEDC AND MUST NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT THE WRITTEN PERMISSION OF MEDC.			
MACHINE SYMBOLS				WELDING TERMS & SYMBOLS TO BS 499 PART 2				GEN. TOLERANCES			
THUS ∇ μ m				CARBON STEEL TO BE WELDED IN ACCORDANCE WITH BS 5135				REMOVE ALL BURRS AND SHARP EDGES			
±0.5				STAINLESS STEEL TO BE WELDED IN ACCORDANCE WITH BS 3019 PT 2 - 1960				WELDS TO BE FREE FROM SLAG & SPLATTER			
±0.5				WELDS TO BE FREE FROM SLAG & SPLATTER				WELDS TO BE FREE FROM SLAG & SPLATTER			